


**NOTES:**

1. PAVERS - PAVERS TO REMAIN 5mm ABOVE TOP OF CURB.  
225 x 112.5 x 60 UNI-PAVE BROWN 'WESTCON' OR APPROVED EQUAL.  
(225 x 112.5 x 80 FOR VEHICLE LOADING AREAS & FIRE LANES)  
ASTM STANDARD C93-82  
-COMPRESSIVE STRENGTH - 55MPa (8000psi)  
-WATER ABSORPTION - <5%
2. BEDDING SAND - UNIFORM THICKNESS OF 30mm COMPACTED,  
WELL GRADED, COURSE CONCRETE SAND.  
SAND BRUSHED INTO CRACKS ONCE PAVERS LAID.
3. SUB-BASE - COMPACTED TO 95% MODIFIED PROCTOR.  
MINIMUM THICKNESS 200mm.
4. SUB-GRADE - COMPACTED TO 95% MODIFIED PROCTOR.

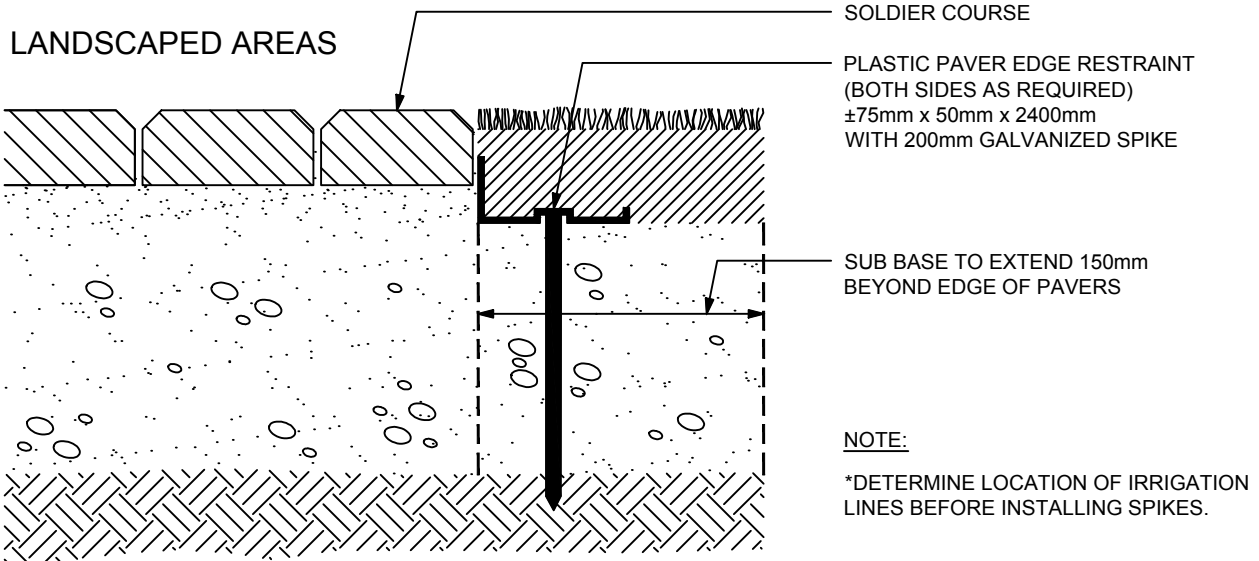

<b>RESORT MUNICIPALITY of WHISTLER</b>	
<b>INTERLOCKING PAVERS</b>	
DRAWN BY: BL	DATE: MAY 2010
SCALE: N.T.S.	DWG. NO.: R6