


**NOTE:**  
 REFER TO RMOW STANDARD DRAWING -  
 SANITARY SERVICE CONNECTION (DWG. NO. S7)  
 FOR DETAILS ON RMOW SIDE OF PROPERTY LINE.

ELECTRICAL CONTROL PANEL TO NEMA 4 STANDARD  
 AS WELL AS MUNICIPAL STANDARDS. INSTALLATION  
 TO BE IN ACCORDANCE WITH BC ELECTRICAL CODE.

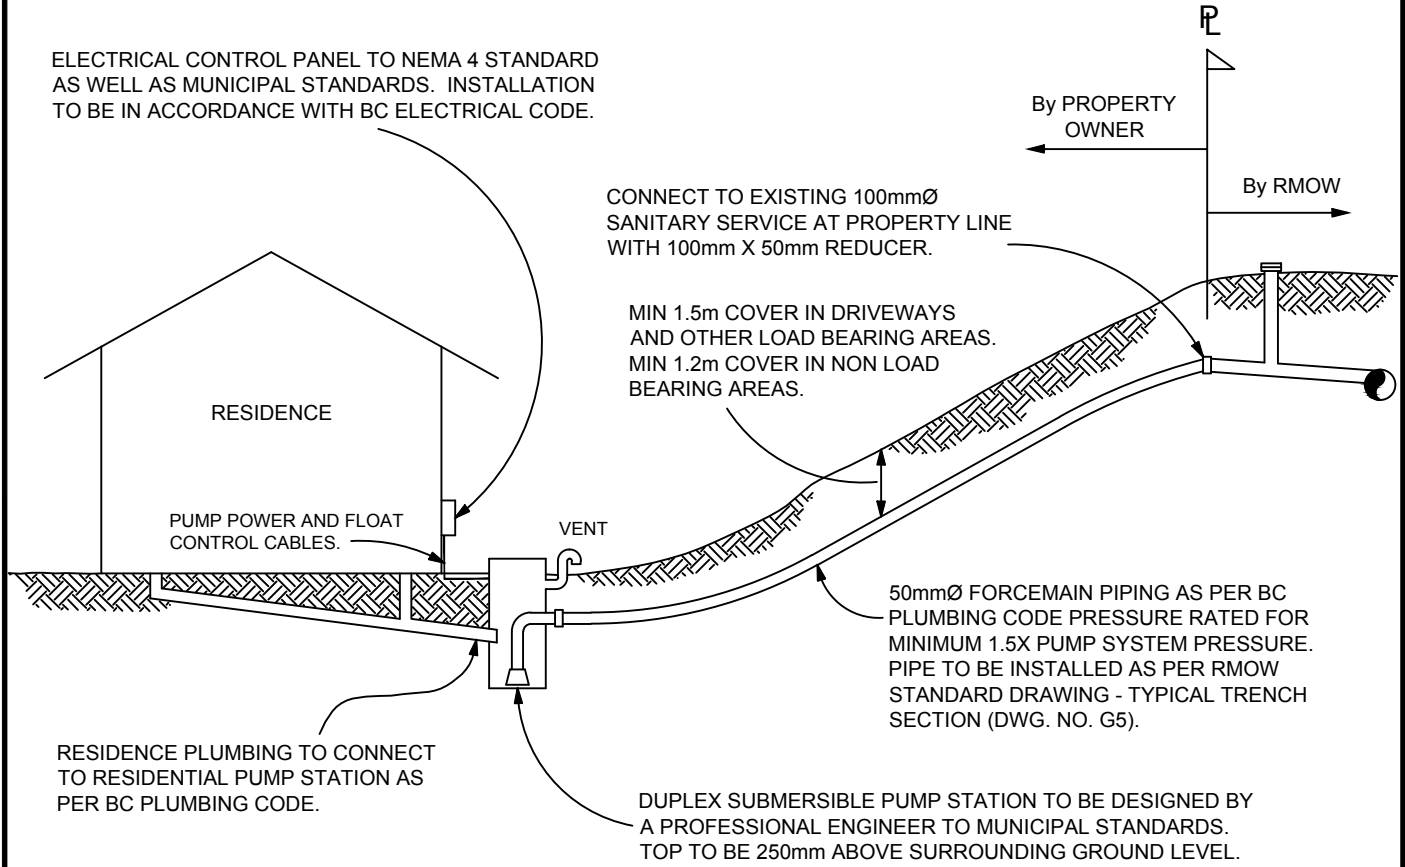

CONNECT TO EXISTING 100mmØ  
 SANITARY SERVICE AT PROPERTY LINE  
 WITH 100mm X 50mm REDUCER.

MIN 1.5m COVER IN DRIVEWAYS  
 AND OTHER LOAD BEARING AREAS.  
 MIN 1.2m COVER IN NON LOAD  
 BEARING AREAS.

50mmØ FORCEMAIN PIPING AS PER BC  
 PLUMBING CODE PRESSURE RATED FOR  
 MINIMUM 1.5X PUMP SYSTEM PRESSURE.  
 PIPE TO BE INSTALLED AS PER RMOW  
 STANDARD DRAWING - TYPICAL TRENCH  
 SECTION (DWG. NO. G5).

DUPLEX SUBMERSIBLE PUMP STATION TO BE DESIGNED BY  
 A PROFESSIONAL ENGINEER TO MUNICIPAL STANDARDS.  
 TOP TO BE 250mm ABOVE SURROUNDING GROUND LEVEL.

RESIDENCE PLUMBING TO CONNECT  
 TO RESIDENTIAL PUMP STATION AS  
 PER BC PLUMBING CODE.



**RESORT MUNICIPALITY of WHISTLER**

**RESIDENTIAL PUMP CONNECTION TO GRAVITY MAIN**

DRAWN BY: BL	DATE: JANUARY 2003
SCALE: N.T.S.	DWG. NO.: S18