


STANDARD MANHOLE FRAME AND COVER MARKED "SAN" TO SUIT


STANDARD 1050mm MANHOLE

REMOVE LIFTING STRAPS AND GROUT FLUSH WITH BARRELL WALL

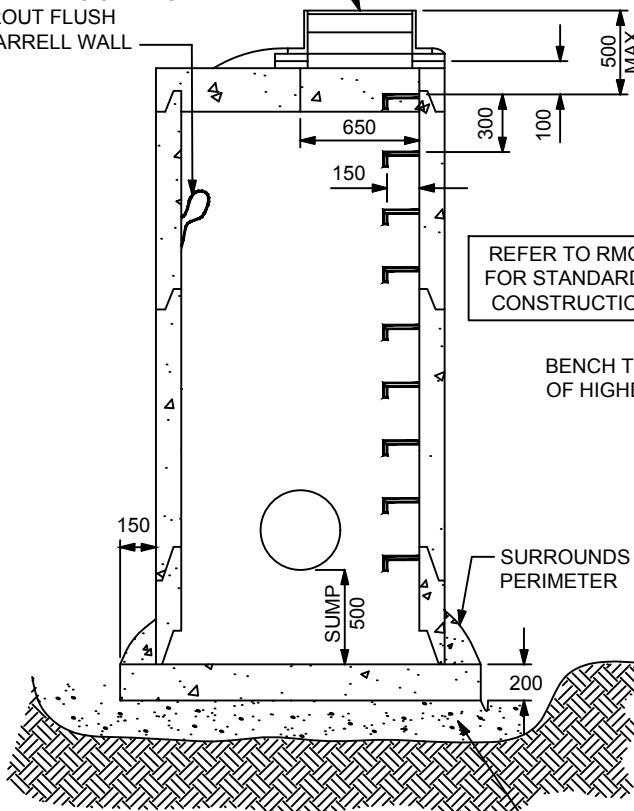

MINIMUM 100mm BEDDING GRAVEL COMPACTED TO 95% MODIFIED PROCTOR DENSITY.

SUMP MANHOLE DURING CONSTRUCTION

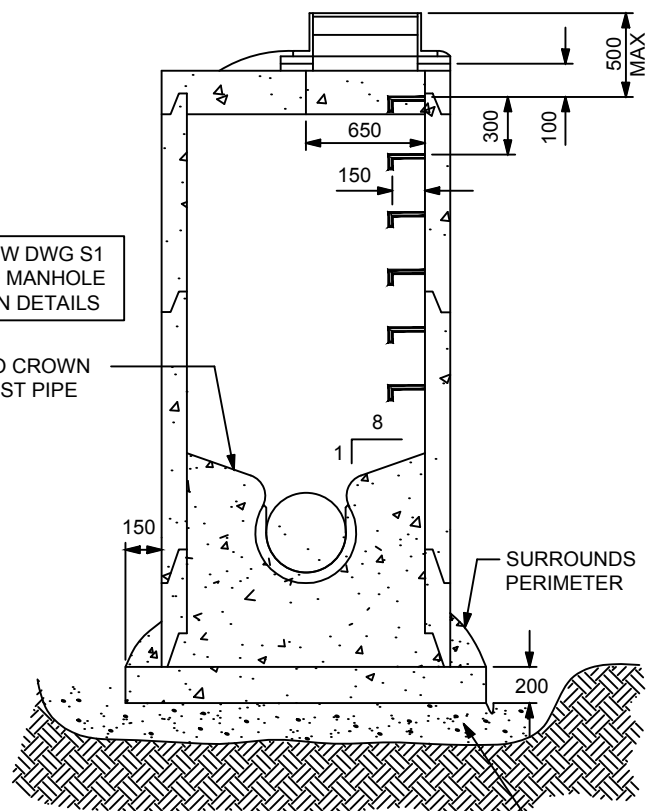

MINIMUM 100mm BEDDING GRAVEL COMPACTED TO 95% MODIFIED PROCTOR DENSITY.

BENCHED MANHOLE AFTER CONSTRUCTION COMPLETED

- NOTE:**
1. DETAILS ARE DRAWN FOR PRECAST RISERS ON CAST-IN-PLACE BASE. PRECAST BASES APPROVED BY ENGINEER ARE ACCEPTABLE.
 2. SUMP MANHOLE TO BE LOCATED AT PROPERTY LINE AND MAINTAINED BY CONTRACTOR UNTIL CONSTRUCTION ACTIVITIES ARE COMPLETED. RMO WILL INSTALL A PLUG IN THE SERVICE IF CONSTRUCTION DEBRIS ENTERS MUNICIPAL SYSTEM.
 3. REFER TO RMO STANDARD DRAWING S1 FOR STANDARD MANHOLE CONSTRUCTION DETAILS.
 4. REFER TO CONTRACT DRAWINGS AND SECTION 02725 FOR DETAILED SPECIFICATIONS.



WHISTLER

**RESORT MUNICIPALITY of WHISTLER
SANITARY INTERCEPT SUMP MANHOLE**

DRAWN BY: PB

DATE: APRIL 2003

SCALE: N.T.S.

DWG. NO.: S19