

March 4, 2019

A – Addendum #1

RFP – Water Main Leak Detection Services - RFP # E21007-2019

The following clarifications are to be made to the RFP as a result of clarification requests and questions received from a Proponent in regards to the intent and scope of the RFP.

Q) Can the closing date be extended?

A) *The RFP Closing Date is extended to April 2, 2019 at 10am.*


Q) Can RMOW confirm provide a map of Alta Vista that clearly shows the fire hydrants and air valves that may be used as entry points for these pipes?

A) *Please see attached map, these entry points have not been field confirmed, but should be used to provide the estimate of services.*

End of Addendum



RMOW Location of Valves and Hydrants in Alta Vista

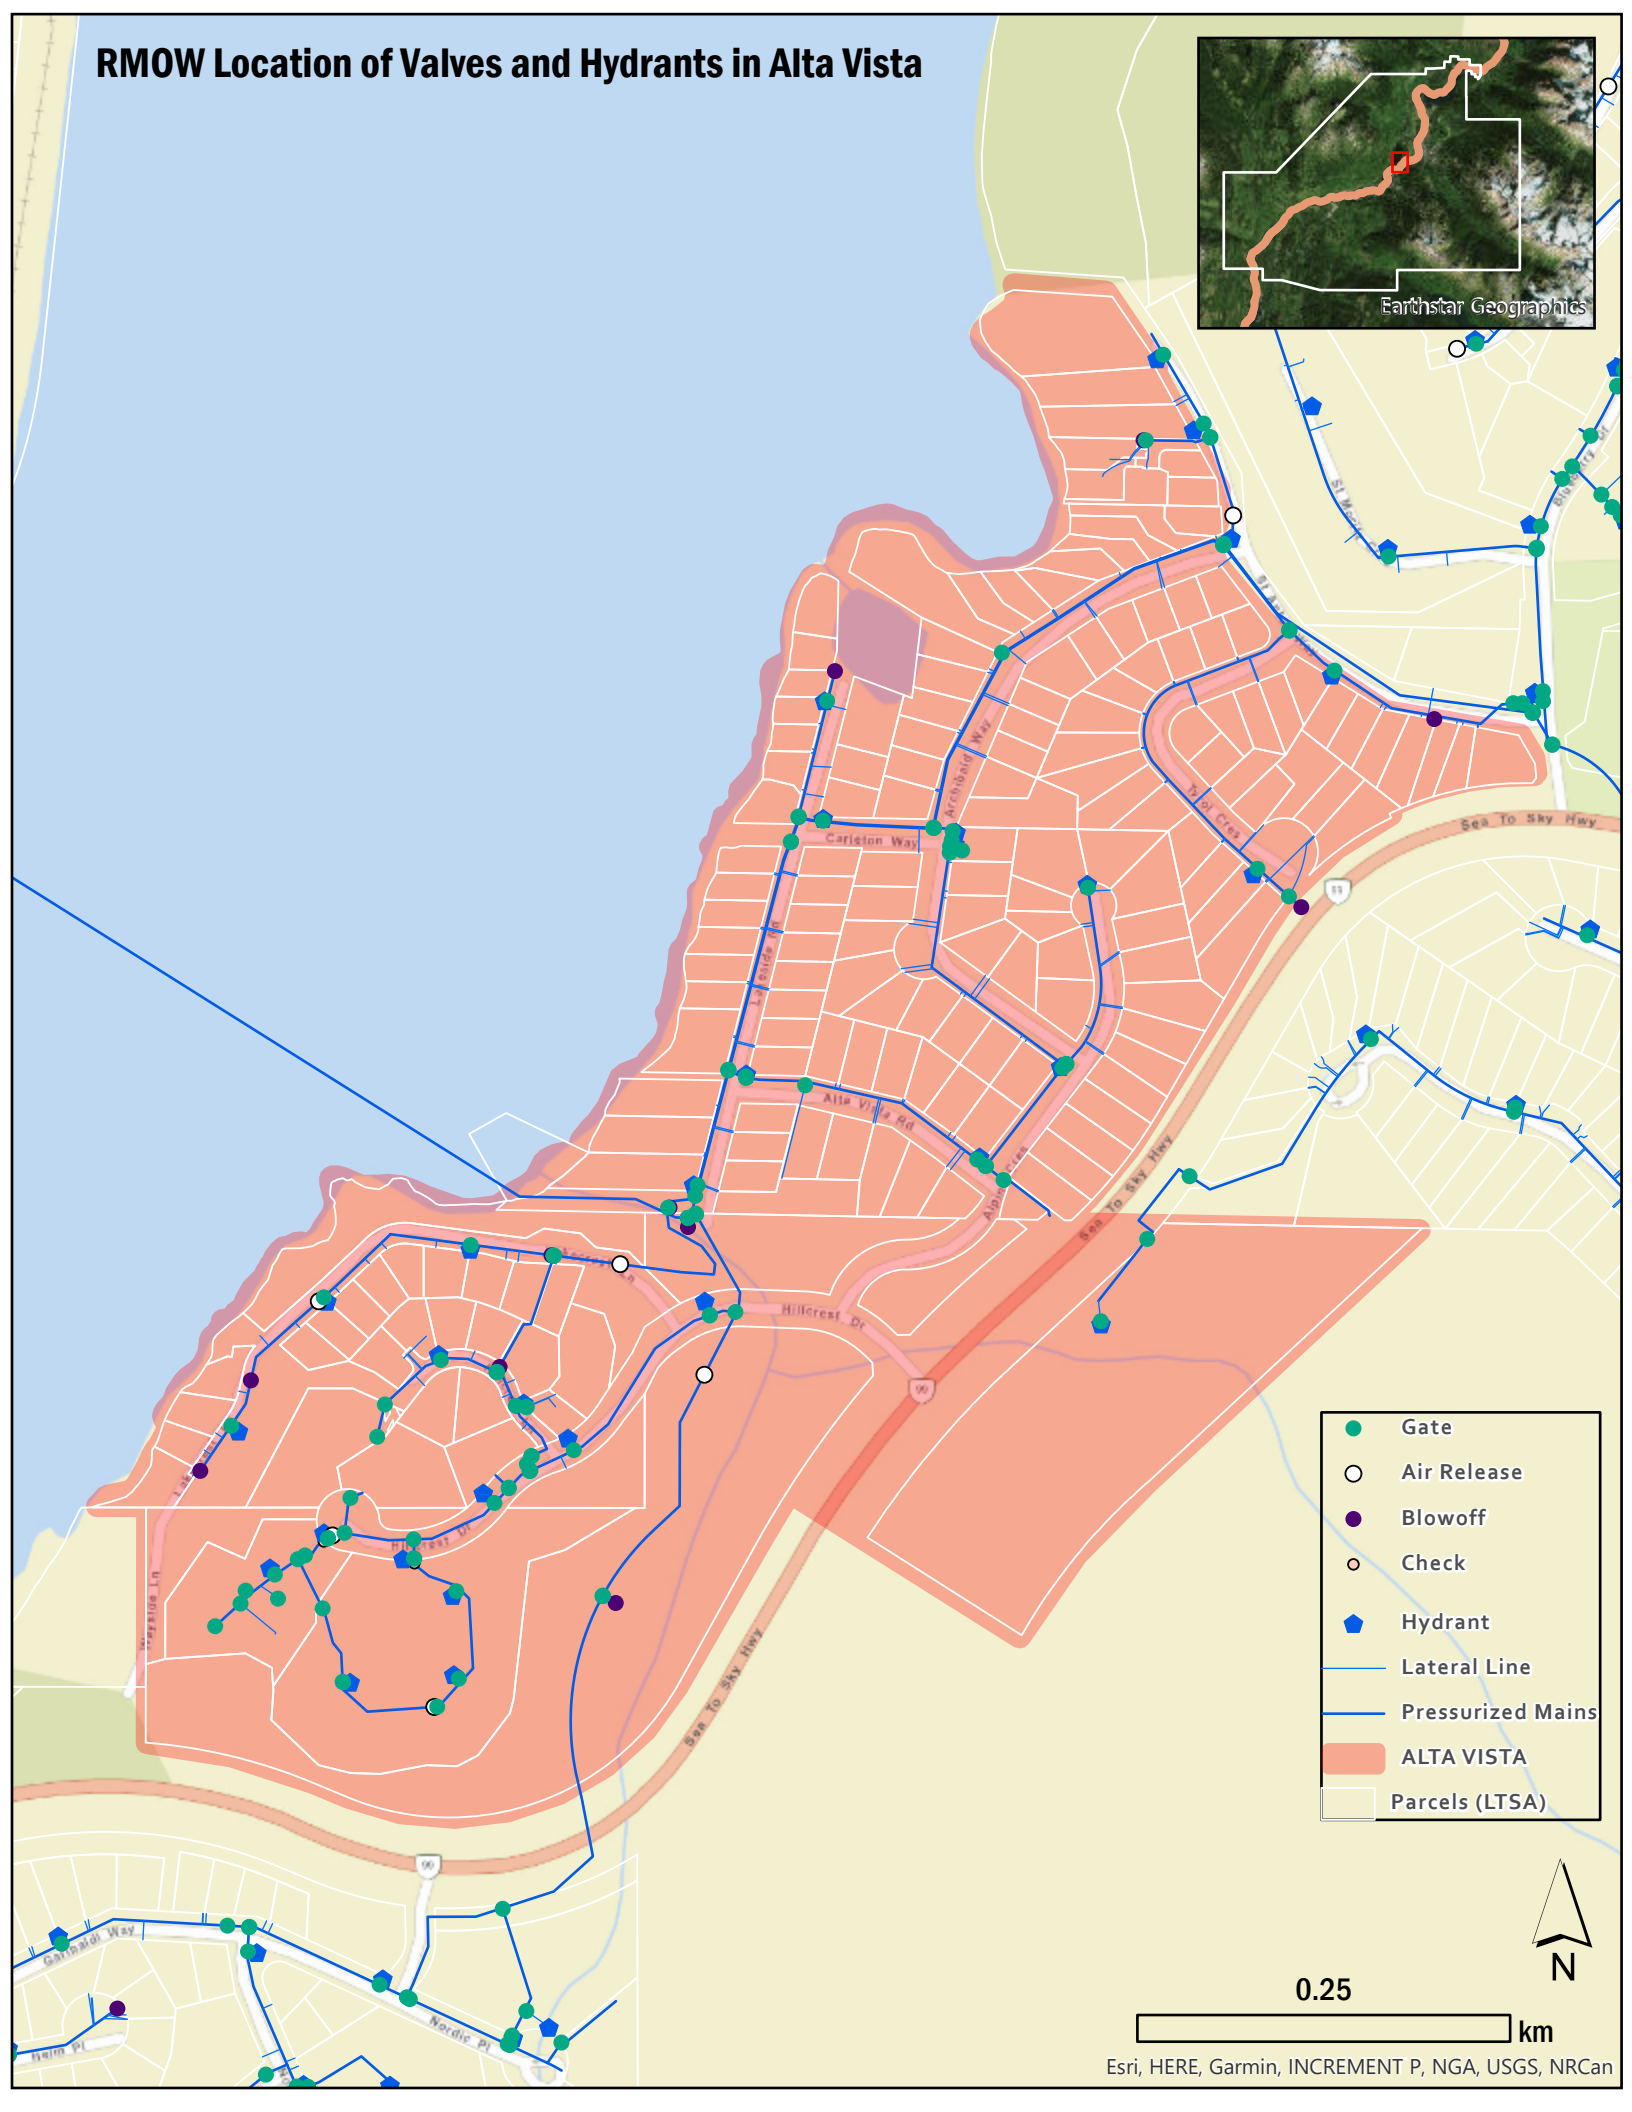

- Gate
- Air Release
- Blowoff
- Check
- ◆ Hydrant
- Lateral Line
- Pressurized Mains
- ALTA VISTA
- Parcels (LTSA)

0.25

km

