


#### NOTES:

1. This detail is applicable only for the concrete encasing of watermains. For concrete protection of underground utilities refer to MMCD standard detail G7.
2. Concrete encasing a watermain does not eliminate the minimum crossing clearance requirements.
3. Watermain joint wrapping is still required where applicable.
4. This detail is also applicable to a watermain crossing another watermain.
5. Watermain concrete encasement is only applicable when the watermain is the upper pipe.

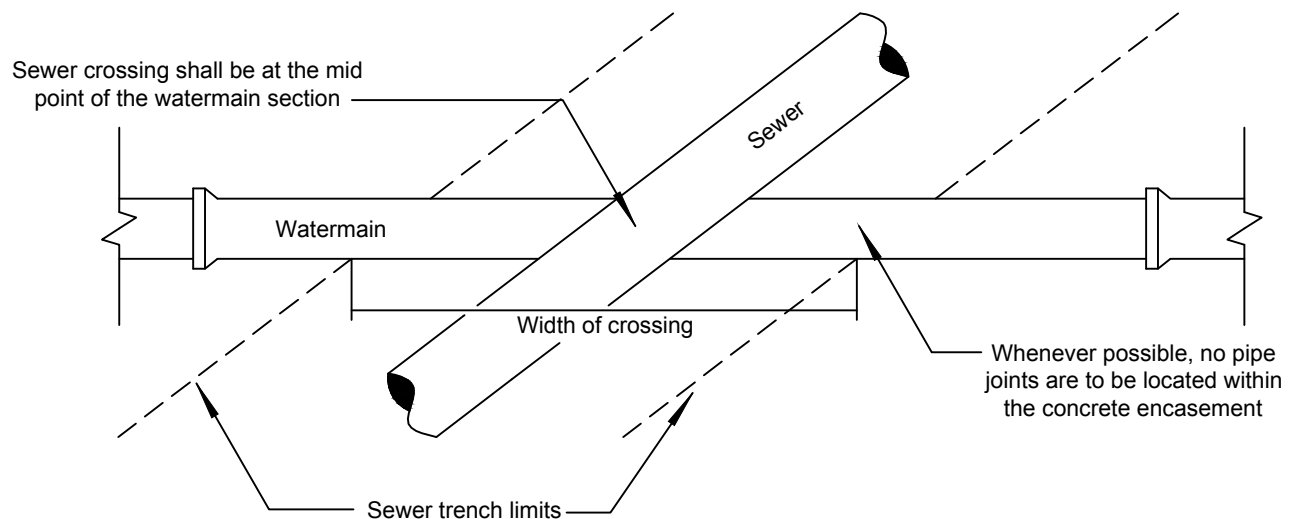

## RESORT MUNICIPALITY of WHISTLER

### CONCRETE ENCASEMENT for WATERMAIN/SEWER SEPARATION

DRAWN BY: BL

DATE: MAY 2017

SCALE: N.T.S.

DWG. NO.: G6