


NOTES:

1. PAVERS - PAVERS TO REMAIN 5mm ABOVE TOP OF CURB.
225 x 112.5 x 60 UNI-PAVE BROWN 'WESTCON' OR APPROVED EQUAL.
(225 x 112.5 x 80 FOR VEHICLE LOADING AREAS & FIRE LANES)
ASTM STANDARD C93-82
-COMPRESSIVE STRENGTH - 55MPa (8000psi)
-WATER ABSORPTION - <5%
2. BEDDING SAND - UNIFORM THICKNESS OF 30mm COMPACTED,
WELL GRADED, COURSE CONCRETE SAND.
SAND BRUSHED INTO CRACKS ONCE PAVERS LAID.
3. SUB-BASE - COMPACTED TO 95% MODIFIED PROCTOR.
MINIMUM THICKNESS 200mm.
4. SUB-GRADE - COMPACTED TO 95% MODIFIED PROCTOR.

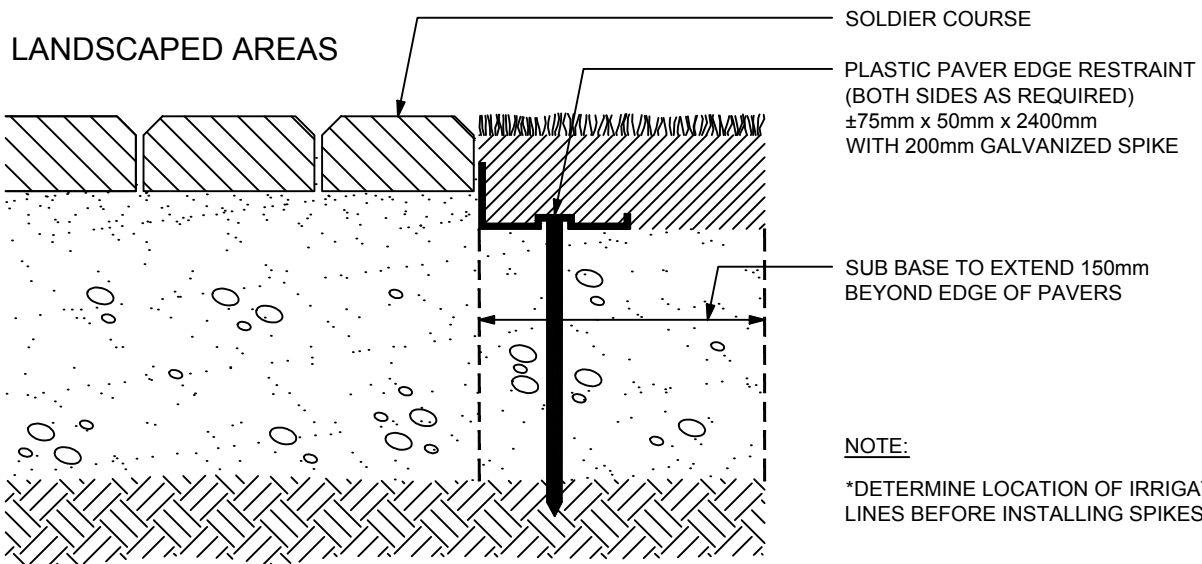

RESORT MUNICIPALITY of WHISTLER
INTERLOCKING PAVERS

DRAWN BY: BL

DATE: MAY 2010

SCALE: N.T.S.

DWG. NO.: R6