


STANDARD MANHOLE FRAME AND
COVER MARKED "SAN" TO SUIT

STANDARD 1050mm MANHOLE

REMOVE LIFTING STRAPS
AND GROUT FLUSH
WITH BARRELL WALL

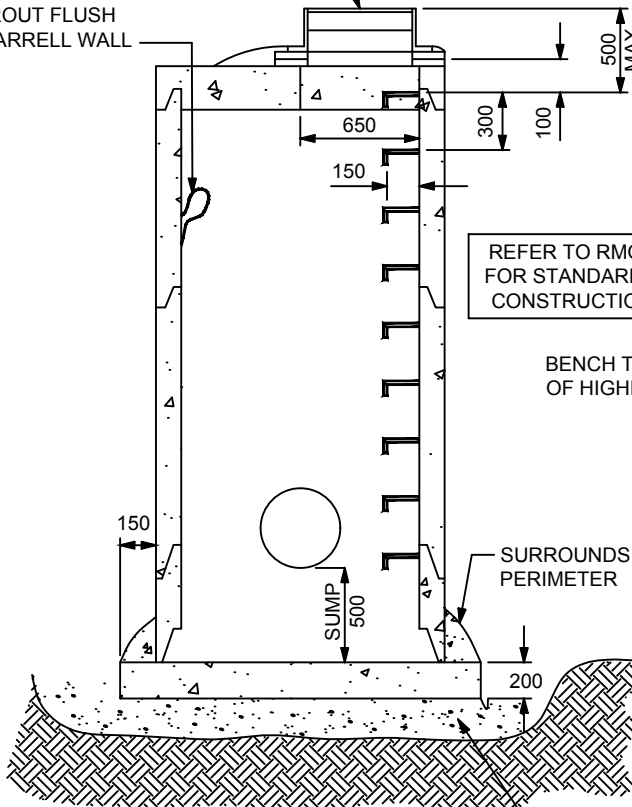


REFER TO RMOW DWG S1
FOR STANDARD MANHOLE
CONSTRUCTION DETAILS

BENCH TO CROWN
OF HIGHEST PIPE

SURROUNDS
PERIMETER

MINIMUM 100mm BEDDING GRAVEL
COMPACTED TO 95% MODIFIED
PROCTOR DENSITY.

SUMP MANHOLE
DURING CONSTRUCTION

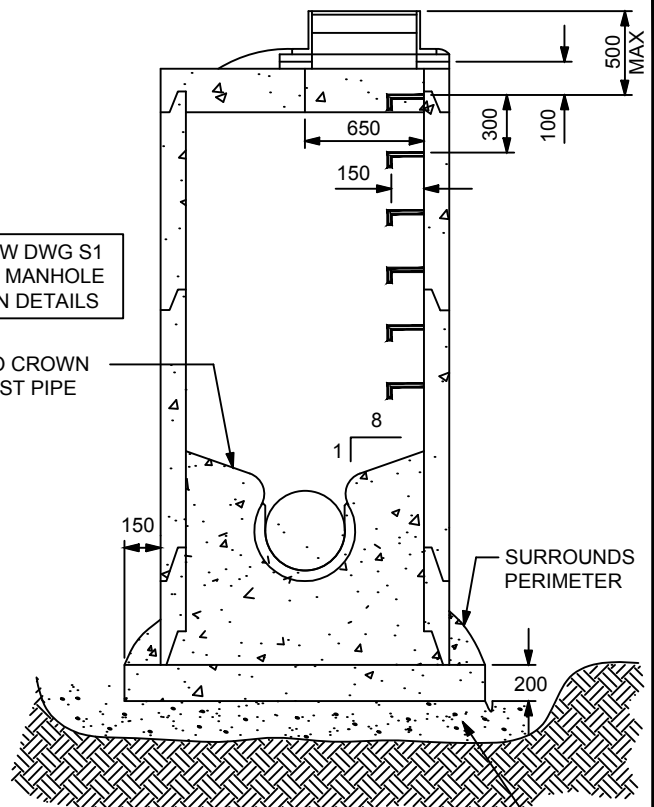

MINIMUM 100mm BEDDING GRAVEL
COMPACTED TO 95% MODIFIED
PROCTOR DENSITY.

BENCHED MANHOLE
AFTER CONSTRUCTION
COMPLETED

- NOTE:**
1. DETAILS ARE DRAWN FOR PRECAST RISERS ON CAST-IN-PLACE BASE. PRECAST BASES APPROVED BY ENGINEER ARE ACCEPTABLE.
 2. SUMP MANHOLE TO BE LOCATED AT PROPERTY LINE AND MAINTAINED BY CONTRACTOR UNTIL CONSTRUCTION ACTIVITIES ARE COMPLETED. RMOW WILL INSTALL A PLUG IN THE SERVICE IF CONSTRUCTION DEBRIS ENTERS MUNICIPAL SYSTEM.
 3. REFER TO RMOW STANDARD DRAWING S1 FOR STANDARD MANHOLE CONSTRUCTION DETAILS.
 4. REFER TO CONTRACT DRAWINGS AND SECTION 02725 FOR DETAILED SPECIFICATIONS.



RESORT MUNICIPALITY of WHISTLER
SANITARY INTERCEPT SUMP MANHOLE

DRAWN BY: PB

DATE: APRIL 2003

SCALE: N.T.S.

DWG. NO.: S19