


1. 19mmØ FORD CORP. STOP OR EQUAL WITH DOUBLE STRAP STAINLESS STEEL SADDLE.
2. 19mmØ FORD CORP. STOP OR EQUAL.
3. McAVITY STANDARD SERVICE BOX c/w RIB COVER & 14mmØ ROD OR EQUAL MUELLER/TROTAM.
4. FOR TRACER WIRE INSTALLATION: TRACE WIRE SHALL BE #12 AWG COPPER CLAD STEEL, HIGH STRENGTH WITH MINIMUM 450LB BREAK LOAD, WITH MINIMUM 30MIL HDPE INSULATION THICKNESS.
5. TRACER WIRE TO BE GROUNDED TO SERVICE BOX USING HOSE CLAMP AND WRAPPED AS NOTED BELOW.
6. ADDITIONAL 300MM OF WIRE TO BE COILED AROUND THE TOP OF THE SERVICE BOX AND END OF WIRE IS TO BE CAPPED WITH MARETTE AND WRAPPED IN ELECTRICAL TAPE.

- WHERE EXCAVATION IS IN ROCK, THE ROCK SHALL BE BLASTED, REMOVED AND ZONE REPLACED WITH COMPACTED GRAVEL BACKFILL FOR A MIN. DISTANCE OF 1.5m BEHIND PROPERTY LINE.

- ALL DUPLEX LOTS SHALL HAVE 2 SEPARATE 19mmØ WATER SERVICE CONNECTIONS.

- APPLY AN APPROVED CORROSION PROTECTION SYSTEM TO ALL BURIED FERROUS FITTINGS, FLANGES, FASTENERS, ETC. SUCH AS "DENSO" PETROLATUM TAPE SYSTEM; INCLUDING PASTE, PROFILING MASTIC AND TAPE AS PER MANUFACTURER'S INSTRUCTIONS, OTHER CORROSION PROTECTION SYSTEMS MAY BE USED UPON APPROVAL OF THE RMOW.

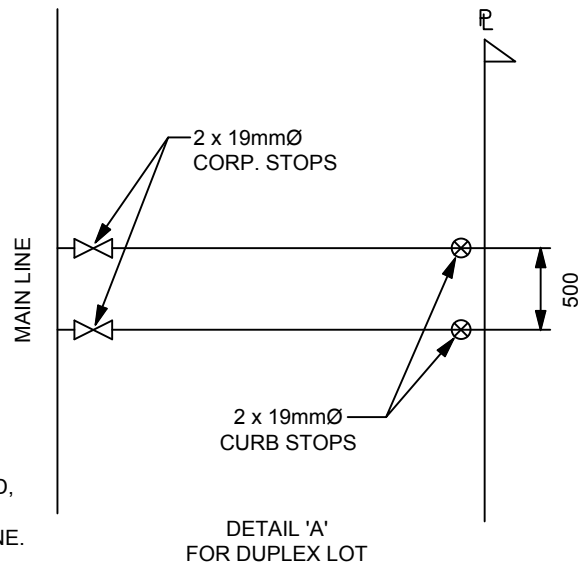

## RESORT MUNICIPALITY of WHISTLER

### STANDARD WATER SERVICE CONNECTION

DRAWN BY: BL

DATE: JANUARY 2018

SCALE: N.T.S.

DWG. NO.: W2-A